



# ULR-50

2-383-9C

Listed Fire Pump & Controller  
NFPA-20 Compliant Packaged System

# 50GPM

Test Port

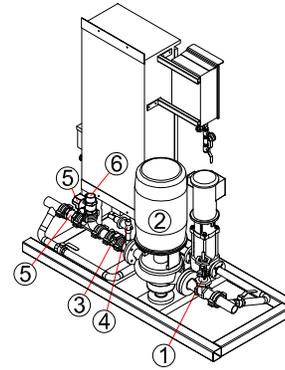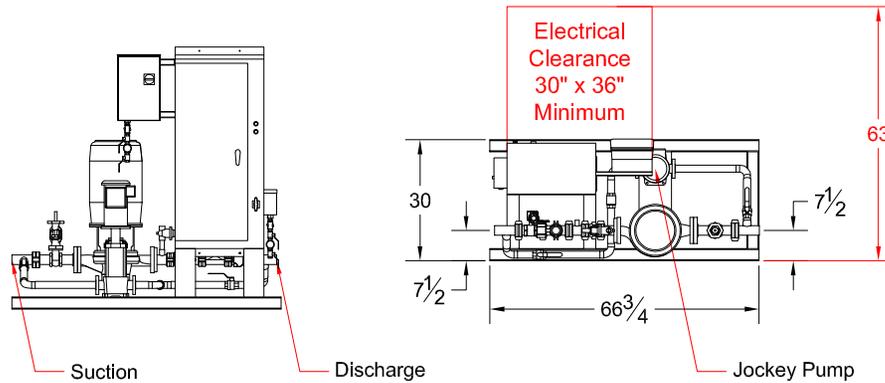


### System Components

1	OS&Y Gate Valve
2	Inline Pump & Motor
3	Check Valve
4	Case Relief Valve
5	Monitored Butterfly
6	2" Test Connection


### Design Conditions

_____	GPM @	_____	PSI
_____	HP	_____	V Phase


Project: _____	
Contractor: _____	
Date: _____	P.O.: _____

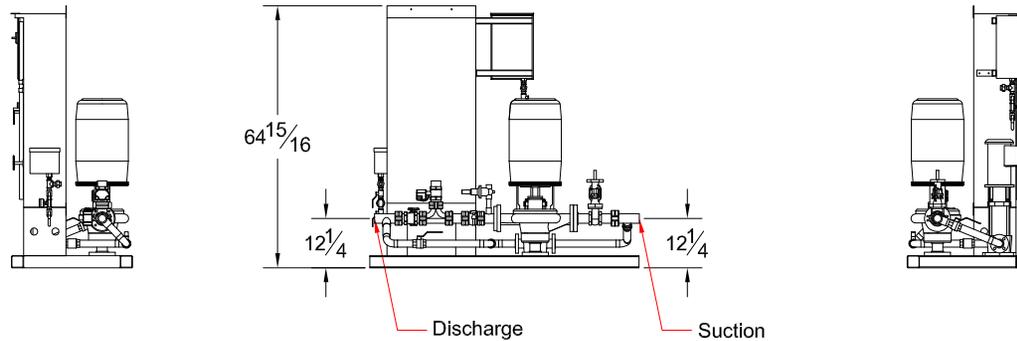

### Jockey System Detail

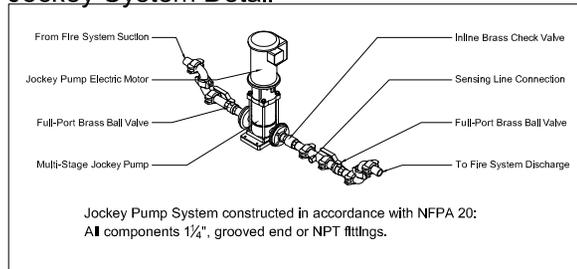

### Sensing Line Detail

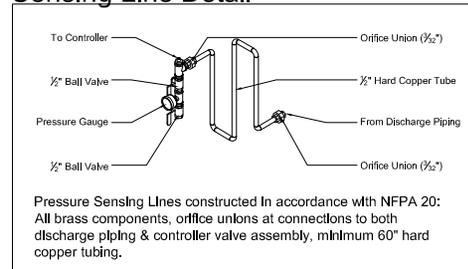

All dimensions inches - Not certified for construction purposes.

Controller: \_\_\_\_\_

Jockey Pump: \_\_\_\_\_

Jockey Controller: \_\_\_\_\_

Suction x Discharge: 2" GRV x 2" GRV

# TALCO FIRE SYSTEMS



RESIDENTIAL & COMMERCIAL FIRE PUMP SPECIALISTS  
6040 NE 112TH AVE. PORTLAND, OREGON 97220  
PHONE: 800-878-8055 WWW.TALCOFIRE.COM